



FirePro.

Technical Prospectus



Reinventing
Fire Suppression

Technical Prospectus

Contents

Introduction 4

Environment 6

How it works 8

Our Technology 9

Benefits & Advantages 12

Product Line 14

Smart Controllers 16

System Design 17

Installation Examples 19

Applications 20

Certificates 22

Clients 25

Global Network 26



At FirePro we design, develop and manufacture ecologically friendly total flooding fire suppression systems. Our technology has at its core the patented FirePro fire suppression condensed aerosol forming solid compound (FPC).

Our pre-engineered systems are subjected to robust and rigorous testing to ensure they comply with the relevant international standards and protocols. In the last two decades, FirePro has been commissioned by a diverse portfolio of prestigious clients in more than 110 countries to protect key assets. FirePro HQ, R&D Division and Manufacturing facilities are based in Cyprus, EU.



Sustainable Future. Today.

Fire suppression systems backed by research, committed to people and the environment.



Environmentally Conscious

The environmentally friendly potassium based condensed aerosol forming solid compound (FPC) was developed following intense R&D. Our dedication to Green and Sustainable Technologies is attested by the number of International Certifications, Listings and Type Approvals from the most reputable and respected organisations in the world. As a result, our products are manufactured using selective and environmentally friendly materials, that can be recycled at the end of their life cycle.



Zero Ozone Depletion

Condensed aerosol technology gained increasing recognition following the Montreal Protocol which banned substances with negative impact on the environment and Ozone layer. In our effort to contribute towards humanity's sustainable development goals, we focused on Green Technologies. As a result, our products are manufactured using selective and environmentally friendly materials, that can be recycled at the end of their life cycle.

FirePro is EPA (U.S. Environmental Protection Agency) SNAP Listed (Significant New Alternative Policy) and is considered to be ozone friendly as it contains no CFC's.



Zero Global Warming Potential

The FPC condensed aerosol forming solid compound does not contain any substances that contribute to global warming, such as those found in other agents e.g. fluorinated gases* used for industrial applications which are banned or are in the process of being banned according to regulation (EU) No 517/2014 of the European Parliament and Council, due to their negative impact on the environment.

***Note:** Fluorinated gases (F-gases) are a family of man-made gases used in a range of industrial applications. Because they do not damage the atmospheric ozone layer, they are often used as substitutes for ozone-depleting substances. However, F-gases are powerful greenhouse gases, with a global warming effect of up to 23,000 times greater than carbon dioxide (CO₂), and their emissions are rising rapidly.



Green Policies

FirePro has been assessed and certified under the GEN (Global Eco-Labeling Network) Green Standard and has been granted the Green Label Certificate.




ISO 9001:2015 and ISO 14001:2015 Certified

FirePro products are manufactured in full compliance with all international standards and requirements regarding quality and environmental management procedures. FirePro maintains ISO 9001:2015 certification and ISO 14001:2015 certification issued by DNV GL.

Our clients can trust that FirePro is committed to actively minimize the environmental impact of its manufacturing processes, products and services, as part of our Corporate Social Responsibility.

Reinventing Fire Suppression

FirePro technology inhibits the chain reactions of fire on a molecular level.

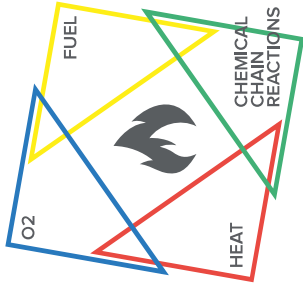

Methods of Fire Suppression

Fire Suppression Method	Description of Method	Commonly used Technologies
Heat Absorption	Fire is suppressed by reducing temperature/heat.	Water based & Gaseous agents
Oxygen Depletion	Fire is suffocated by depleting/displacing oxygen.	Inert gaseous agents
Chemical Inhibition	Fire is suppressed by directly interrupting the chemical chain reactions on a molecular level.	Condensed Aerosols

FirePro Extinguishing Agent Action

1. Fire is a series of chemical chain reactions. The flame free radicals ($O^{\cdot 2}$, $H^{\cdot}$, $OH^{\cdot}$) act as chain carriers, sustaining the flame until at least one of the three elements of the fire is completely depleted.

2. In the presence of fire, the potassium carbonate (K_2CO_3) which is the active agent in the condensed aerosol medium undergoes thermal dissociation, forming unstable potassium free radicals ($K^{\cdot}$) which act as chemical chain reaction inhibitors.

3. Chain termination occurs when $K^{\cdot}$ are bound to the flame free radicals by forming stable potassium hydroxide (KOH).

4. KOH reacts further in the presence of CO_2 to form potassium carbonate (K_2CO_3). The cycle continues until the chemical chain reaction terminates and the fire is extinguished.

More than one Protection Strategies

FirePro offers pre-engineered, total flooding certified solutions for: Class A, B, C & F fire hazards. (according to European EN 2 Standard)
Class A, B & C fire hazards (according to NFPA 10 Standard)

DEFINITION OF TOTAL FLOODING ACCORDING TO NFPA 2010:

As per section 3.3.27 of NFPA 2010 Standard for Fixed Aerosol Fire-Extinguishing Systems, a total flooding extinguishing system is a system arranged to discharge an extinguishant/suppressant into an enclosure achieving a uniform distribution.

SCOPE OF APPLICATIONS

I. Large Enclosures

e.g. : *Electrical rooms, Transformer rooms, Storage, Generator rooms, Archives.*

FirePro condensed aerosol generators, due to their modular nature, provide fire suppression for enclosures of any volume.

The main consideration when using FirePro condensed aerosol generator in total flooding system installations, is the dynamics of aerosol distribution.

To ensure rapid and even distribution of the condensed aerosol in the protected volume, the positioning of the generators requires careful study that considers layout and positioning of objects within.

II. Small Enclosures

e.g. : *Electrical Panels / Cabinets*

The FirePro range includes probably the smallest existing autonomous and automatic fire extinguishing systems. These are used internally to protect, on a total flooding basis, small enclosures such as electrical panels or other power utilizing devices/equipment.

Small enclosure protection is becoming increasingly important due to the high sensitivity and high asset value of today's equipment. For this reason, it is imperative, that any fire occurring in such applications is suppressed at an early stage, preventing its escalation, and restricting it from causing any further damage.

FirePro Generator Technology

A FirePro condensed aerosol generator is a metal container that houses:

- i) FPC Solid Compound
- ii) Electrical Actuator
- iii) Cooling Material
- iv) Mesh separators
- v) other mechanical parts



STAINLESS STEEL ENCLOSURE

The generator is a cylindrical enclosure made of durable, sustainable and 100% recyclable stainless steel. It accommodates the activation (electrical & thermal) ports. The generator is fully protected against corrosion.

Note: The box type condensed aerosol generators are produced in both stainless steel and red coated mild steel.

ELECTRICAL ACTUATOR

Upon detection of a fire the releasing panel sends a pulse of electrical energy to the electrical actuator that acts as an electrical heating element to initiate the transformation of the FPC Compound into condensed aerosol.

ACTIVATION PORTS

Each FirePro condensed aerosol generator comes with two types of activation ports (thermal and electrical) thus providing the engineering option to utilize one or more methods of activating the device depending on application.

FPC SOLID COMPOUND

The patented condensed aerosol forming solid compound has a certified lifetime of up to 15 years and found to withstand temperatures of up to +250°C.

NATURAL CERAMIC COOLANT

High quality alumina ceramic spheres act as both a cooling medium (due to their high conductive nature) but also as a filter that traps coarse aerosol particles.

DISCHARGE PORT

Point from which the condensed aerosol exits the generator.

AEROSOL AGENT

A condensed aerosol is defined as a 2-phased medium consisting of solid particles suspended in a gas. FirePro aerosol consists of Potassium based particles – active agent, suspended in a gas carrier.

Technology Essential Facts

 Certified 15-year product life	 Non Pressurized	 Non-Oxygen Depleting
 HFC-free	 CFC-free	 Zero Global Warming Potential
 ODS Listed Alternative	 Zero Ozone Depletion Potential	 Manufactured under ISO 9001:2015 ISO14001:2015
 Minimum Maintenance	 Cost-effective	 Durable & Robust

FirePro offers the following to all relevant stakeholders that define it as the system of choice and earning the respect of the engineering society.

TECHNOLOGY FACTS:

- Full compliance with standards
- Environmentally friendly
- Land & Marine applications
- 15 years certified product life

GREAT FOR THE INSTALLER:

- Easy to install
- Safe to handle
- Easily transported
- Fewer system components

GREAT FOR THE SPECIFIER:

- Pre-engineered
- Easily retrofitted
- Simple system integration
- Non pressurized system
- Certified for Occupied Areas

GREAT FOR THE END USER:

- Low cost of ownership
- Speedy installation process
- Minimal space requirements
- Minimal maintenance requirements

FirePro Generators

FirePro condensed aerosol generators are made using the highest quality materials and are listed/certified by UL, ULC, BSI, KIWA, LPCB and other Notified Bodies.

RANGE

The FirePro product range includes generators of various sizes, from the smallest 20g unit to the largest 5700g (g refers to the weight of the FPC solid compound within the condensed aerosol generator). They can be used singularly or in combination to protect both small volumetric enclosures, such as electrical panels and/or large warehouses, power generation plants, and many more.

INTEGRATION

FirePro condensed aerosol generators are integrated by using an advanced range of control & indicating panels and state-of-the-art thermo bulb self-activating devices (otherwise known as stand-alone systems) that operate without electrical power.



FP-20

Gross Weight (g): 310
Net Mass of FPC Compound (g): 20
Dimensions (mm): H: 165 x Ø: 32



FP-40

Gross Weight (g): 610
Net Mass of FPC Compound (g): 40
Dimensions (mm): H: 140 / Ø: 51



FP-80

Gross Weight (g): 870
Net Mass of FPC Compound (g): 80
Dimensions (mm): H: 185 / Ø: 51




FP-200

Gross Weight (g): 1840
Net Mass of FPC Compound (g): 200
Dimensions (mm): H: 185 / Ø: 84




FP-500

Gross Weight (g): 3340
Net Mass of FPC Compound (g): 500
Dimensions (mm): H: 295 / Ø: 84




FP-1200

Gross Weight (g): 10900
Net Mass of FPC Compound (g): 1200
Dimensions (mm): 216X300X167



FP-2000

Gross Weight (g): 15500
Net Mass of FPC Compound (g): 2000
Dimensions (mm): 300X300X185



FP-3000

Gross Weight (g): 16300
Net Mass of FPC Compound (g): 3000
Dimensions (mm): 300X300X185



FP-4200

Gross Weight (g): 23600
Net Mass of FPC Compound (g): 4200
Dimensions (mm): 300X300X300



FP-5700

Gross Weight (g): 26400
Net Mass of FPC Compound (g): 5700
Dimensions (mm): 300X300X300



ATEX Models



Cylindrical Models

FP-100EX

Gross Weight (g): 1830
Net mass of FPC Compound (g): 100
Dimensions (mm): H:170 / Ø: 84

FP-200EX, FP-500EX

Box Type Models

FP-1200EX

Gross Weight (g): 17050
Net mass of FPC Compound (g): 1200
Dimensions (mm): 365 x 450 x 310

**FP-2000EX, FP-3000EX
FP-4200EX, FP-5700EX**

Fire Protection Controllers



FPC-1

The FirePro FPC-1 Fire Protection Controller provides monitoring, detection and means to initiate the automatic fire suppression process by using the incorporated rate of rise heat sensor or extended linear heat detection cable.

Two outputs are provided to connect to the FirePro condensed aerosol generators and disconnection of any one of the two will signal a fault condition.

Open collector contacts are available to signal fire, fault and state of power conditions to other monitoring equipment. The FPC-1 is powered by 4 batteries 1.5V.




FPC-2

The FirePro FPC-2 Fire Protection Controller provides monitoring, detection and means to initiate the automatic fire suppression process by using the external detector such as heat, smoke or a linear heat detection cable.

Four outputs are provided for the connection of FirePro condensed aerosol generators and disconnection of any one of these will announce a fault condition.


Volt-free contacts are available to signal fire and fault conditions to monitoring equipment. The FPC-2 requires an external 24V DC power supply backed with batteries capable of delivering 3A.

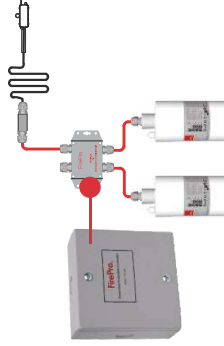

FPC-4RV3

The FirePro FPC-4RV3 Fire Protection Controller provides detection and means to initiate the automatic fire suppression (with up to two FirePro condensed aerosol generators) process using the external linear heat detector cable.

Volt-free contacts are available to signal fire conditions to monitoring equipment. The electrical panel protection module FPC-4RV3 can have primary and secondary power sources, capable each, individually or in combination, of providing the necessary arrangement to activate the two condensed aerosol fire suppression units.



FPC-5V2

The FirePro thermal activation protection module FPC-5V2 can detect fire and activate a condensed aerosol generator automatically in electrical cabinets and similar enclosures.



GTN-25

Magnets substitute the bolts necessary for installing the cylindrical FirePro fire condensed aerosol generators. The GTN-25 magnet can be used with the brackets for all cylindrical condensed aerosol generator models.



Bulb Thermal Actuator (BTA) - Autonomous actuation device

The FirePro BTA can detect fire and activate a condensed aerosol generator with the use of a bulb thermal sensor of a pre-selected temperature.

- Orange 57°C
- Red 68°C
- Yellow 79°C
- Green 93 °C
- Blue 141 °C
- Mauve 182°C



Total Flooding Designing a pre-engineered system



Our Design Principles

The primary objective of fire protection is to safeguard human life, valued assets and the environment from the catastrophic effects of fire.

FirePro can be installed in any enclosure of any volume always in compliance with the local fire legislation, standards and norms.

Design calculation methods are described in detail, in the engineering guidelines of the NFPA 2010, ISO 15279, EN 15276 and IMO Circular MSC.1/Circ.1270 found in FPECS.

A FirePro total flooding system design, takes into account the following parameters:

- Class of the fire hazard.
- Enclosure volume.
- Internal layout.
- Possible openings of the enclosure.



Correct Positioning of the System CAG

The mass of FirePro FPC solid compound required for total flooding calculation is based on the design parameters. The FirePro Engineering Calculation Software (FPEC*) is developed for this purpose. The type and number of FirePro units and other system components are selected to create a fully integrated solution (see page 18).

The system's designer is responsible for the positioning of the FirePro generators to ensure the most efficient distribution of the condensed aerosol in order to achieve total flooding (always complying with the guidelines as described in FirePro User Manual and FPECS*).


System Maintenance

Scheduled mandatory maintenance of FirePro systems must be performed by certified and qualified personnel. This process is relatively simple, time and, cost effective. It does not involve any hydrostatic tests or agent refilling procedures, commonly required by other conventional fire suppression systems.

Note: All installations, maintenance and replacement of discharged condensed aerosol generators must be carried out by FirePro certified and authorized personnel only.

* For System Design Download and Use FPECS from Partner's Network

Typical System Design for Room Total Flooding

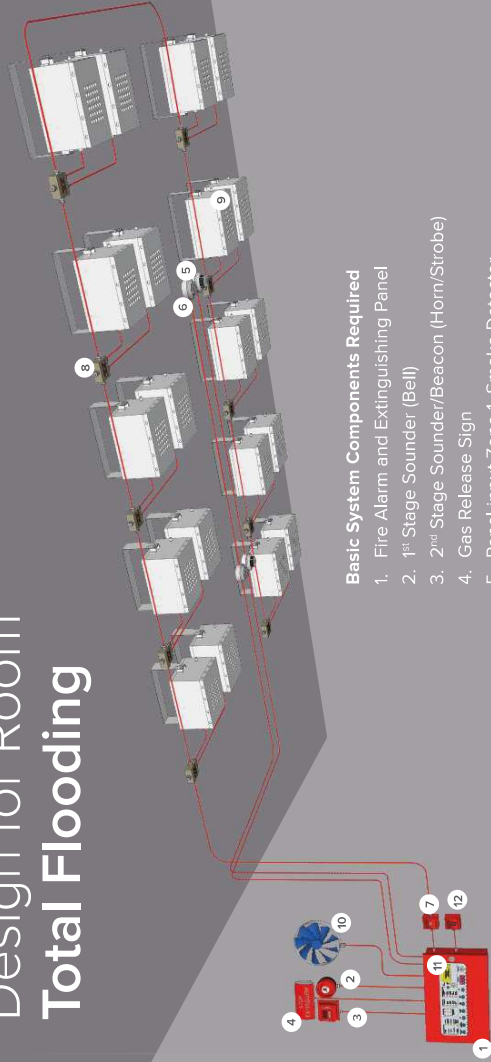

Basic System Components Required

1. Fire Alarm and Extinguishing Panel
2. 1st Stage Sounder (Bell)
3. 2nd Stage Sounder/Beacon (Horn/Strobe)
4. Gas Release Sign
5. Panel Input Zone 1, Smoke Detector
6. Panel Input Zone 2, Heat Detector (RoR)
7. Extinguishant Disablement Switch (System Isolation Switch)
8. Sequential Activator
9. FirePro condensed aerosol generators
10. Emergency Power-Off System
11. Manual Release Button
12. System Abort (Hold) Switch

* For system Design Download and Use
FPECS
from Partners Network

Note:

- FirePro offers system components according to the application (both for Land or Marine environments) in compliance with local and international regulations, standards and norms.
- Please refer to our product catalogue available online, for the complete list of FirePro system components.
- FirePro extinguishant control panels, can be integrated with the most commonly used addressable fire detection systems, broadly available in the international market.

Designing a FirePro total flooding system is based on the formula illustrated below:

$$m(g) = V(m^3) * d_a (g/m^3) * f_a$$

$$m(g) = V(m^3) * EAD (g/m^3) * SF * f_a$$


m(g)	Agent solid mass
V(m³)	Protected volume
d_a (g/m³)	Design application density
d_a (g/m³)	EAD * SF
EAD (g/m³)	Extinguishing application density
SF	Safety factor (30%)=1.3
f_a	Additional design factors

THE ABOVE DESIGN FORMULAS ARE ACCORDING TO NFPA2010 STANDARD.

Serving 30+ Industries



Transportation

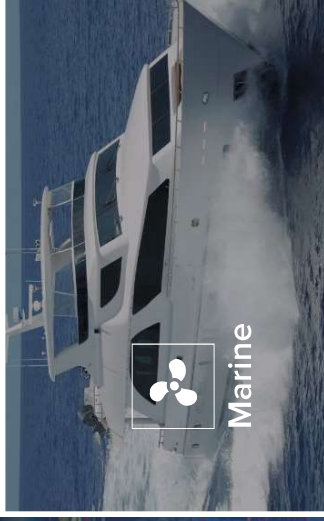

Marine



Power Generation



Manufacturing



Renewables



Petrochemicals




Mining

Numerous Core Applications

FirePro systems are used in all conventional applications as well as in those that were once considered to be technically or financially challenging by other technologies.



**Electrical
Panels**

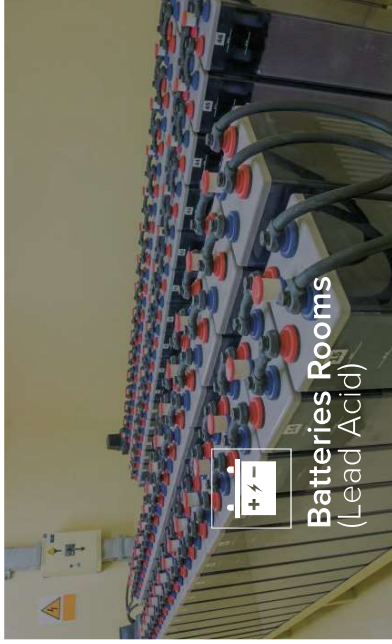

**Batteries Rooms
(Lead Acid)**




**Energy Storage
Systems (Li-ion)**



**Electrical Control
Rooms**



**Archive
Rooms**

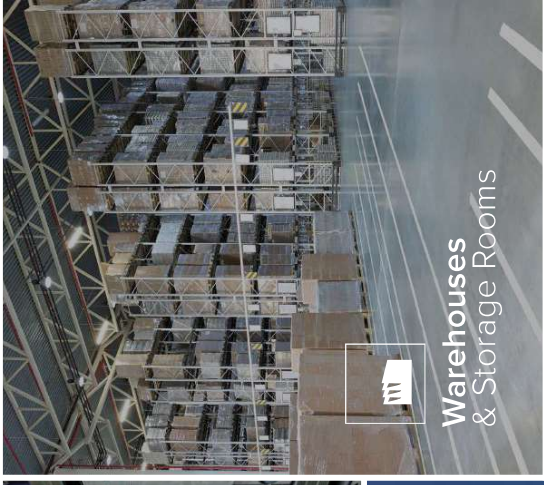


**Warehouses
& Storage Rooms**



**Power Transformer
Rooms**




**Diesel Generators
Rooms**

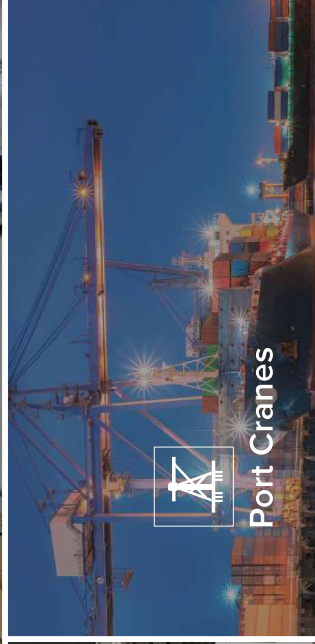

Port Cranes



**Marine Engine
Rooms**

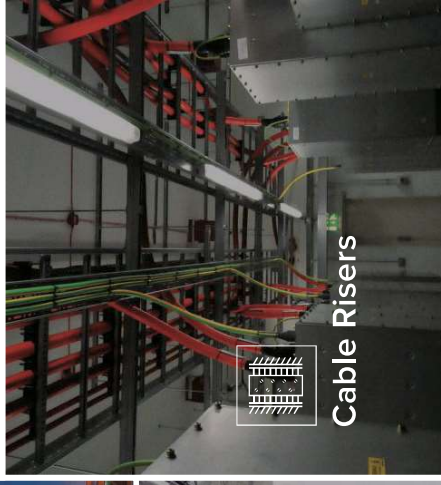

Cable Risers

International Certificates & Standards

FirePro complies and constantly seeks to be in line with the most respected national and international certificates, approvals and test requirements in the fire suppression industry.

Condensed Aerosol Technology Standards:



International Organization
for Standardization
Standard
ISO 15779



International Maritime
Organization
Standard
IMO MSC.1/Circ.1270



European Committee
for Standardization
Standard
EN 15276



National Fire Protection
Association
Standard
NFPA 2010



UL - Underwriters
Laboratories INC.
Standard
ANSI/CAN/UL/ULC
2775



KIWA NV
Standard
BRL-K23001



Standards Australia
Standard
AS 4487-2013



GOST - Russian
Quality Standards
Standard
GOST R 51046-97
Fire Engineering
Generators of
extinguishing aerosol



KFI - Korea
Fire Institute
Standard
Guideline for the
Automatic
Condensed Aerosol
Fire Extinguisher

FirePro Listings, Certifications & Approvals FOR LAND APPLICATIONS:



UL - Underwriters
Laboratory
ULC - Underwriters
Laboratories
of Canada
Certification Protocol
Standard ANSI/CAN/UL/ULC 2775:2019
Condensed Aerosol
Extinguishing Units
Reference
FWSA EX6960
FWSA EX6960



BSI - British Standards
Institution
Certification Protocol
BRL-K23001 Aerosol
Generating Fire
Extinguishing System
Units
Reference
Kitemark License
Number KM 547633



KIWA NV
Certification Protocol
BRL-K23001 Aerosol
Generating Fire
Extinguishing System
Units
Reference
Product Certificate
K21774



LPCB -
Loss Prevention
Certification Board
Reference
1417a Issue:01



CSIRO - Commonwealth
Scientific & Industrial
Research
Certification Protocol
AS 4487-2013 & UL 2775
Fixed Condensed Aero-
sol Extinguishing Units
Reference
ActivFire Certificate of
Conformity alp-2286



CNBOP PIB - Scientific
& Research Center for
Fire Protection
Certification Protocol
EN 15276-1:2009 Con-
densed Aerosol Fire
Extinguishing Systems
Reference
Certificate of Conformity
NR. 4/2015



KFI - Korea Fire Institute
Certification Protocol
Guideline for the
Automatic
Condensed Aerosol
Fire Extinguisher
Reference
Sogong 15-23-1




GOST - Russian
Quality Standards
Certification Protocol
GOST R 51046-97 Fire
Engineering
Generators of
extinguishing aerosol
Reference
GOST TP 1389534



Global Mark
Certification Protocol
AS 4487-2013
Condensed
Aerosol Fire
Extinguishing Systems
Reference
42783209BA28F38F
CA257F5B00152E55

FOR MARINE APPLICATIONS:



British Standards Institution

Description

Wheel Mark in Compliance with MED 2014/90/EU

Reference

BSIA1/3.46/560436
Module B & BSIMED/PC/560437 Module D



ABS - American Bureau of Shipping

Certification Protocol

IMO MSC1/Circ1270 - UL 2775

Reference

Product Design Assessment
19-GE1827109-PDA



BV - Bureau Veritas

Certification Protocol

IMO MSC1/Circ1270

Reference

Type Approval Certificate 31670/BO BV



RINA

Registro Italiano Navale

Certification Protocol

IMO MSC1/Circ1270

Reference

Type Approval Certificate FPE096016XG



RS - Russian Maritime Register of Shipping

Certification Protocol

IMO MSC1/Circ1270

Reference

Type Approval Certificate '16.00094.279



European Certification Bureau B.V.

Reference

Certificate of Compliance No. 15031995



United Kingdom Maritime & Coastguard Agency

Reference

Certificate of Inspection & Test MS 22/3/910



Australian Maritime Safety Authority

Reference

TE: AFP 07 09 23 1tr



Danish Maritime Authority

Reference

Type Approval Certificate 199925855



Hellenic Register of Shipping

Reference

4232/9



Netherlands Shipping Inspectorate

Reference

IWW-06KU00014



Icelandic Maritime Administration

Reference

506.00102



Swedish Maritime Administration

Reference

070202-04-15563




Norwegian Maritime Authority

Reference

200416148-9/556

“FirePro’s bespoke system solutions, 24/7 service and superior quality are measurable advantages.”

Always agile to any threat, our systems are trusted by **industry leaders** around the world

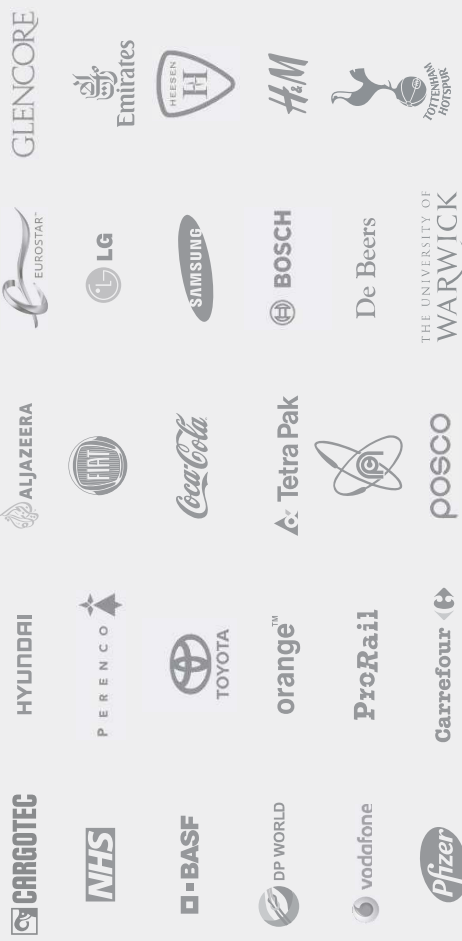

Global Network

We are proud of our Global Network of carefully selected Distributors. Each one undergoes a rigorous training program to best be prepared for the challenges in our industry. Their technical expertise and dedicated resources ensure that each geographic area of responsibility is served with speed, quality and effectiveness.

EUROPE

Albania
Austria
Belgium
Bulgaria
Croatia
Cyprus
Czech Republic
Denmark
Estonia
Finland
France
Georgia
Germany
Greece
Hungary
Iceland
Ireland
Italy
Latvia
Lithuania
Luxembourg
Malta
Netherlands
Norway
Poland
Portugal
Romania
Serbia
Slovakia
Spain
Sweden
Switzerland
Turkey
United Kingdom

AMERICAS

Argentina
Brazil
Canada
Chile
Colombia
Mexico
Peru
Uruguay
U.S.A.
New Zealand
Philippines
Singapore
South Korea
Sri Lanka
Taiwan
Thailand
Vietnam

GULF &

MIDDLE EAST

Bahrain
Iraq
Jordan
Kuwait
Lebanon
Oman
Qatar
Saudi Arabia
UAE

AFRICA

Algeria
Botswana
Congo
Egypt
Ghana
Ivory Coast
Kenya
Liberia
Mauritius
Morocco
Nigeria
South Africa
Sudan
Tanzania
Tunisia

**Global Headquarters,
R&D and Production Facilities**
Limassol, Cyprus EU

Find us on:
www.firepro.com

LIMITED PRODUCT WARRANTY

FirePro Systems Limited ("FirePro Systems") hereby certify that all FirePro Condensed Aerosol Fire Extinguishing Units ("FirePro Condensed Aerosol Units") are built to the industry's highest engineering and manufacturing standards, are rigorously inspected and are covered by a warranty: (i) to be free from defects in material and workmanship and (ii) to be in proper working condition. The warranty does not cover defects resulting from modification, alteration or misuse and exposure to corrosive conditions or exceptionally high temperatures.

The warranty is valid provided that the FirePro Condensed Aerosol Units have been installed by a suitably trained and authorized technician in accordance with the FirePro Systems User Manual and the Customer records verify that the FirePro Condensed Aerosol Units have been serviced and maintained in accordance with the User Manual.

PRODUCT DISCLAIMERS

Except as provided above, FirePro Systems makes no representations or warranties of any kind, whether express or implied, statutory or otherwise for the FirePro Condensed Aerosol Fire Extinguishing units and Systems, including but not limited to warranties of merchantability, fitness for a particular purpose, of title, or of non-infringement of third party rights, including the intellectual property rights of others.

LIMITATION OF LIABILITY

In no event, regardless of cause, shall FirePro Systems be liable for any indirect, special, incidental, punitive or consequential damages of any kind, whether arising under breach of contract, tort (including negligence), strict liability or otherwise, even if advised of the possibility of such damages.

NOTE

FirePro is constantly updating its products and systems to the state of the art and therefore reserves the right to make changes in design, equipment and technology. You cannot therefore base any claims on the data, illustrations or descriptions contained in this literature.

NOTE TO READER

This Technical Prospectus is a point of reference for FirePro channel partners and industry associates. It provides an overview of our technology, its advantages and capabilities, as well as several technical parameters and specifications. For more detailed information on any of the FirePro products and/or the FirePro system components refer to the specific User Manual.

